



Control Panel Identification Label for Holland

EN NL

1

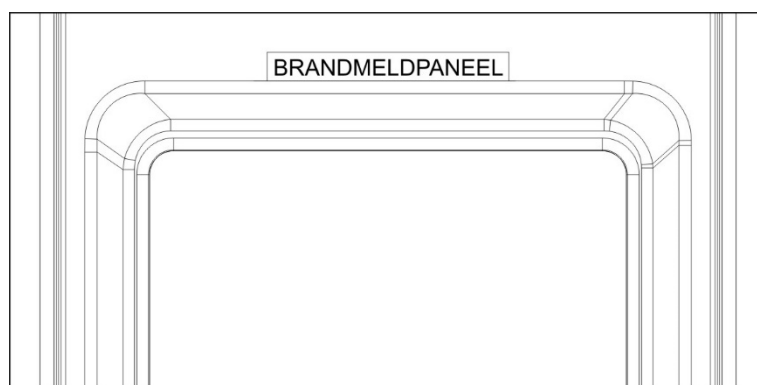

2

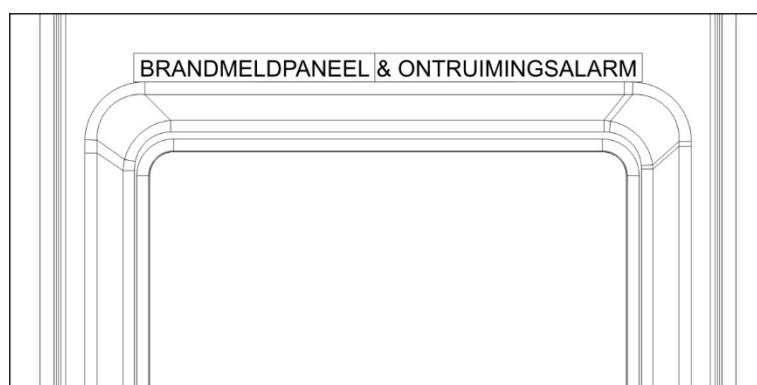

EN: Identification labels

In accordance with NEN2535 and NEN2575 this control panel requires an identification label to be placed at the time of installation.

If installing a fire alarm panel, place the BRANDMELDPANEEL label onto the front of the cabinet, as shown in Figure 1.

If installing an evacuation alarm panel, place both BRANDMELDPANEEL and the ONTRUIMINGALAARM labels onto the front of the cabinet, as shown in Figure 2.

NL: Identificatie labels

Vanuit de NEN 2535 en NEN2575 dient het paneel voorzien te worden van een identificatie label.

Plaats bij installatie van een brandmeldpaneel het label BRANDMELDPANEEL op de voorzijde van de behuizing zoals in figuur 1.

Plaats bij installatie van een ontruimingscentrale beide labels BRANDMELDPANEEL en ONTRUIMINGSALARM op de voorzijde van de behuizing zoals in figuur 2.